




Rev. 4-16-07

Knox County Fire Prevention Bureau Sprinkler System 175 PSI Pressure Relief Valve

Sprinkler system 175 pressure relief valve required for all wet sprinkler systems.
(Can be installed on inspectors test valve or at the riser)

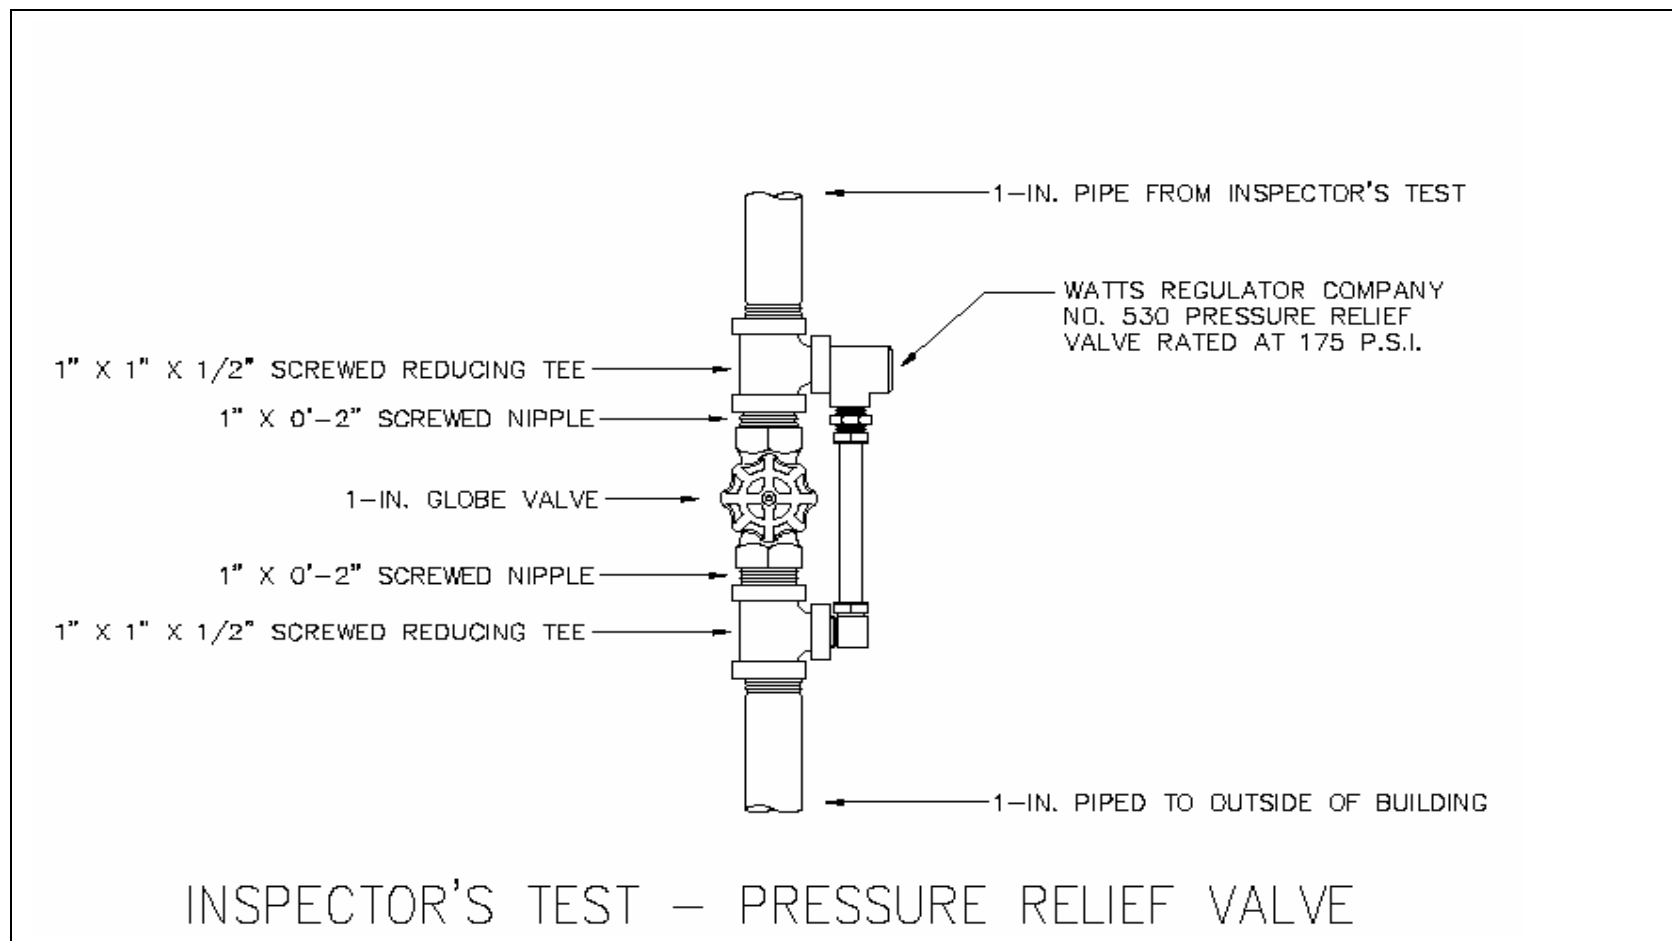

This handout is intended as a guide. It is by no means all-inclusive or has all code related sections listed. If you have questions regarding this information please contact the Knox Co. Fire Prevention Bureau at 215-4660